

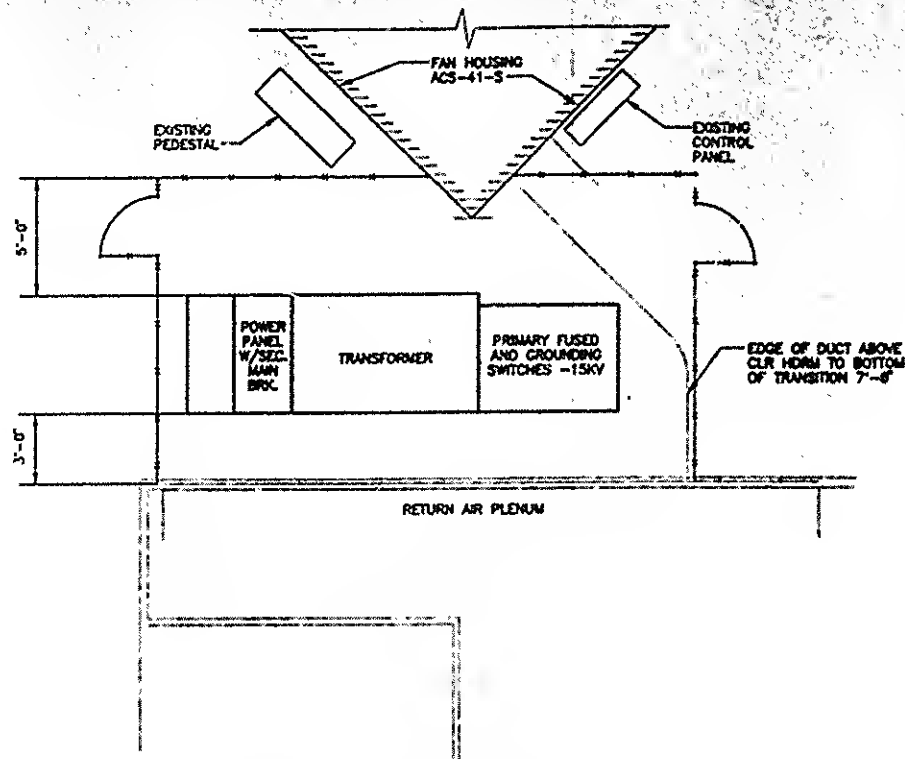



41ST FLOOR PART PLAN



PART PLAN 41ST FLOOR MER
1000KVA - 13.8KV SUBSTATION

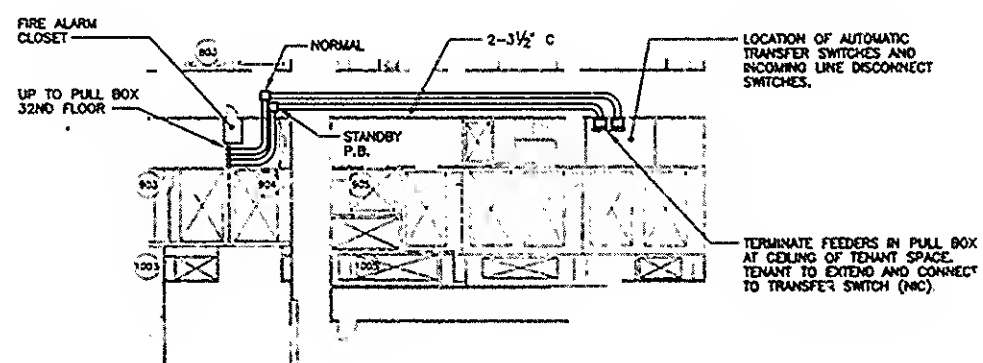


31ST FLOOR PART PLAN



NOTES:

1. PROVIDE #3/0 GROUND CONDUCTOR BONDING JUMPER CONNECTION FROM THE TRANSFORMER SECONDARY DERIVED SOURCE POINT TO THE NEAREST STRUCTURAL STEEL.



PULL BOX 18"x6"x10" (TYP.) WITH CABLE SUPPORT (TYPICAL)

PULL BOX WITH CABLE SUPPORT STANDBY POWER

LOCATION OF CABLE SUPPORT BOX AT 40TH, 36TH & 32ND FLOOR ONLY

PROVIDE 6" CONCRETE PAD AT EVERY FLOOR AFTER CABLE INSTALLATION IS COMPLETED.